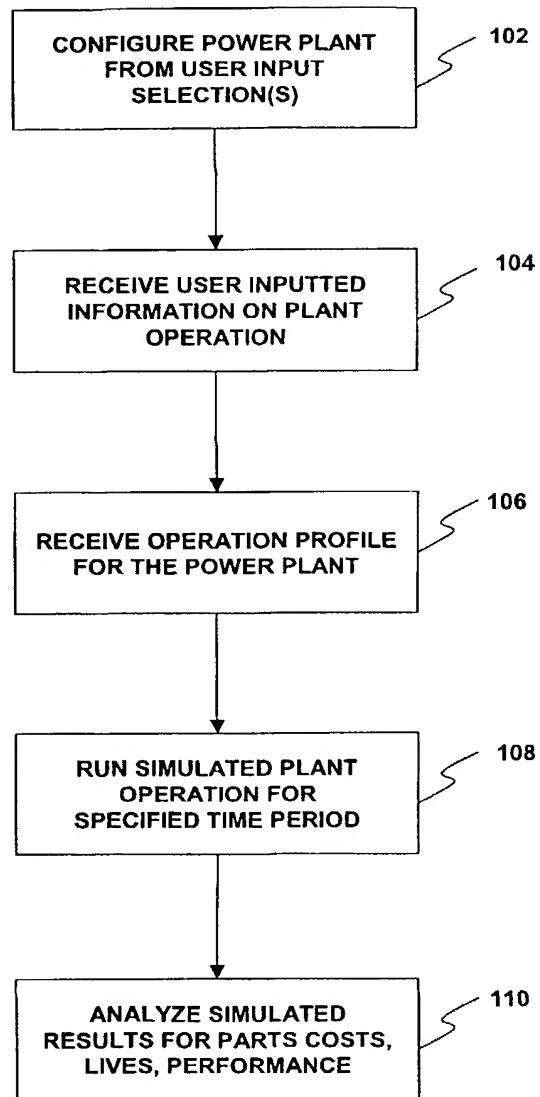


100**FIG. 1**

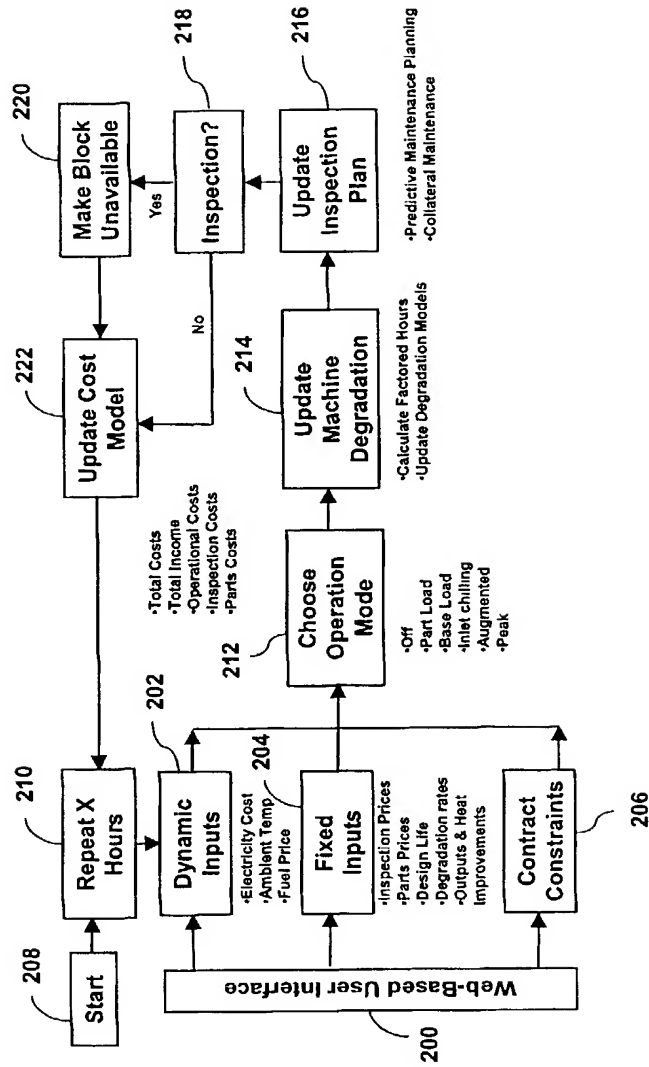


FIG. 2



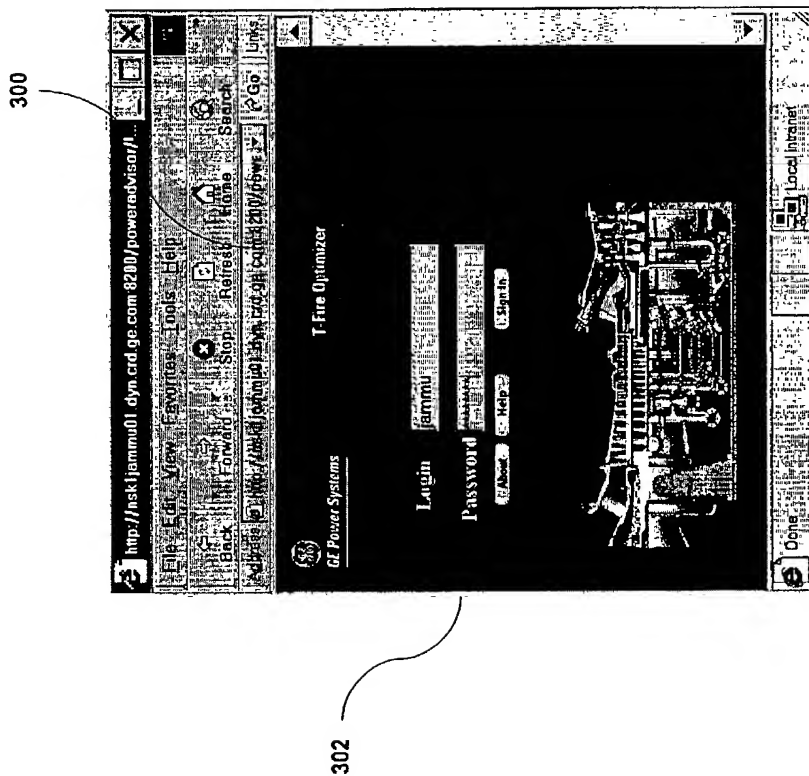



FIG. 3

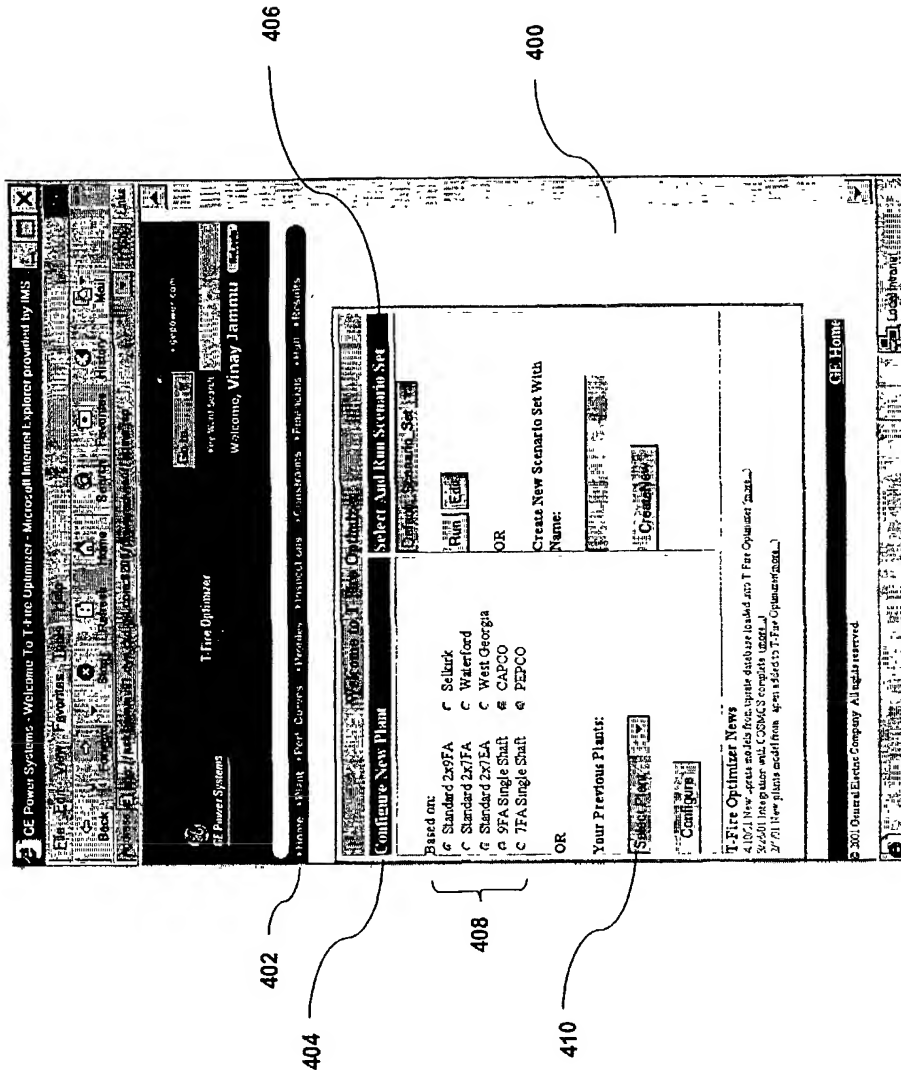

**FIG. 4**

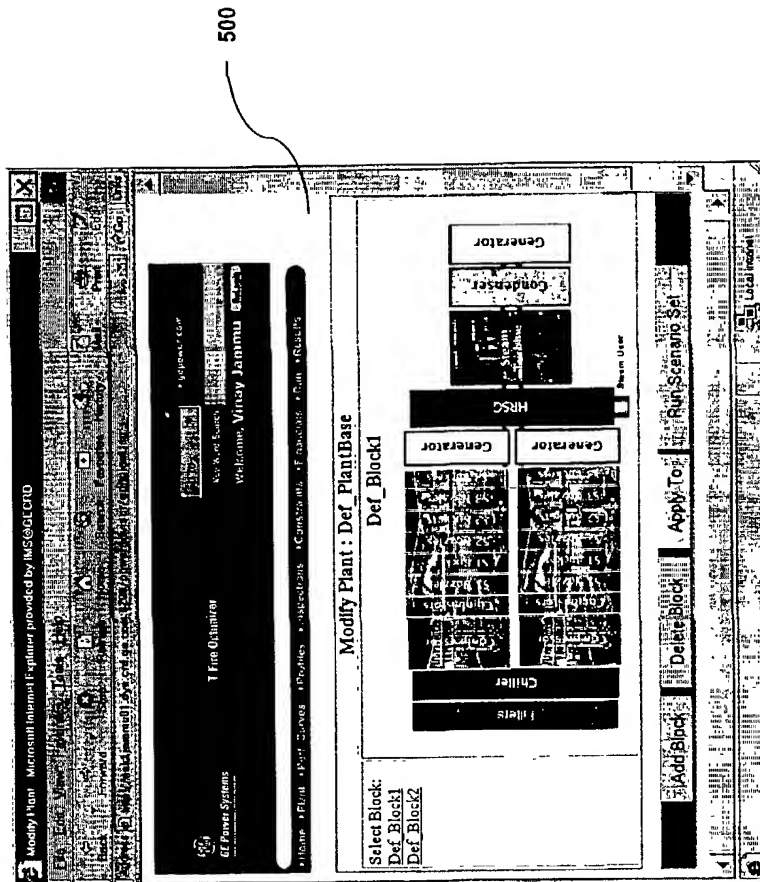

**FIG. 5**

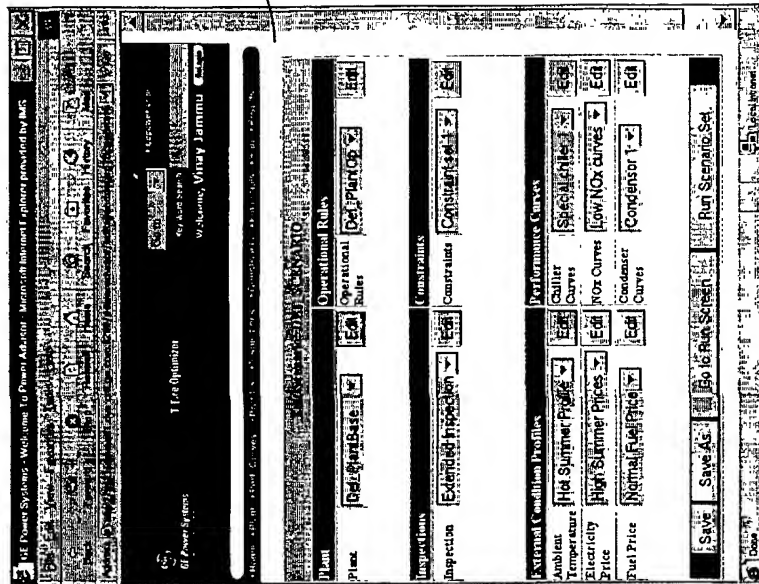

**FIG. 6**



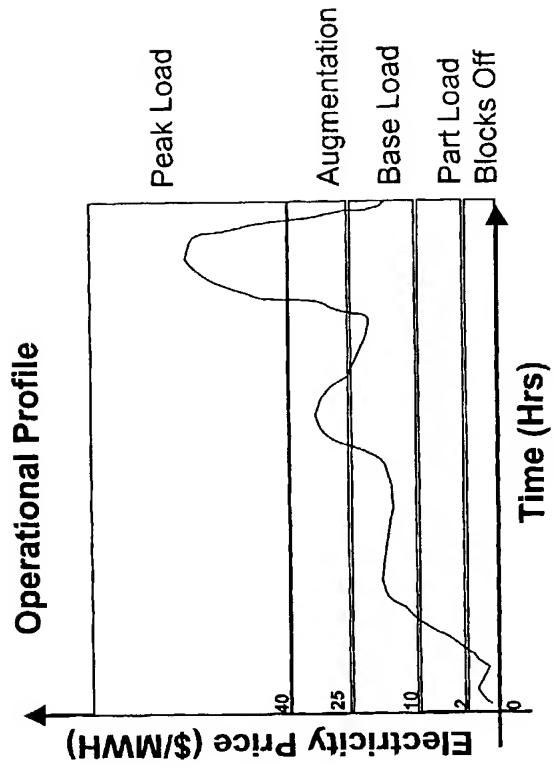


FIG. 8



Customer Operational Cost and Profit 902

Customer Financials		Baseline	Improved	Compressor	Difference
Customer Operation Cost (\$, MM)		130.79	130.79	130.45	-0.34
Customer Profit (\$, MM)		252.52	254.62	254.62	2.10

Constraint Violation: Max Plant Output 904

Plant Max Output Constraint		Baseline	Improved	Compressor	Difference
Hrs of Plant Constraint Violated (Hrs)		1572.00	3294.00	3294.00	1722.00
MW of Plant Output Violated (MW)		20429.56	48896.37	48896.37	28466.81
\$ Lost (\$, MM)		7.89	10.51	10.51	2.62

Time Series Plot of Cumulative Operational Cost and Profit

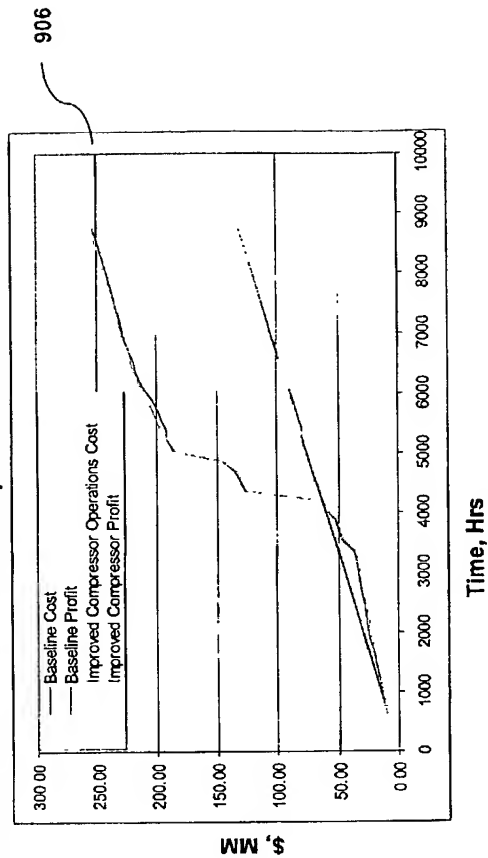


FIG. 9

10065860 1 23 2023

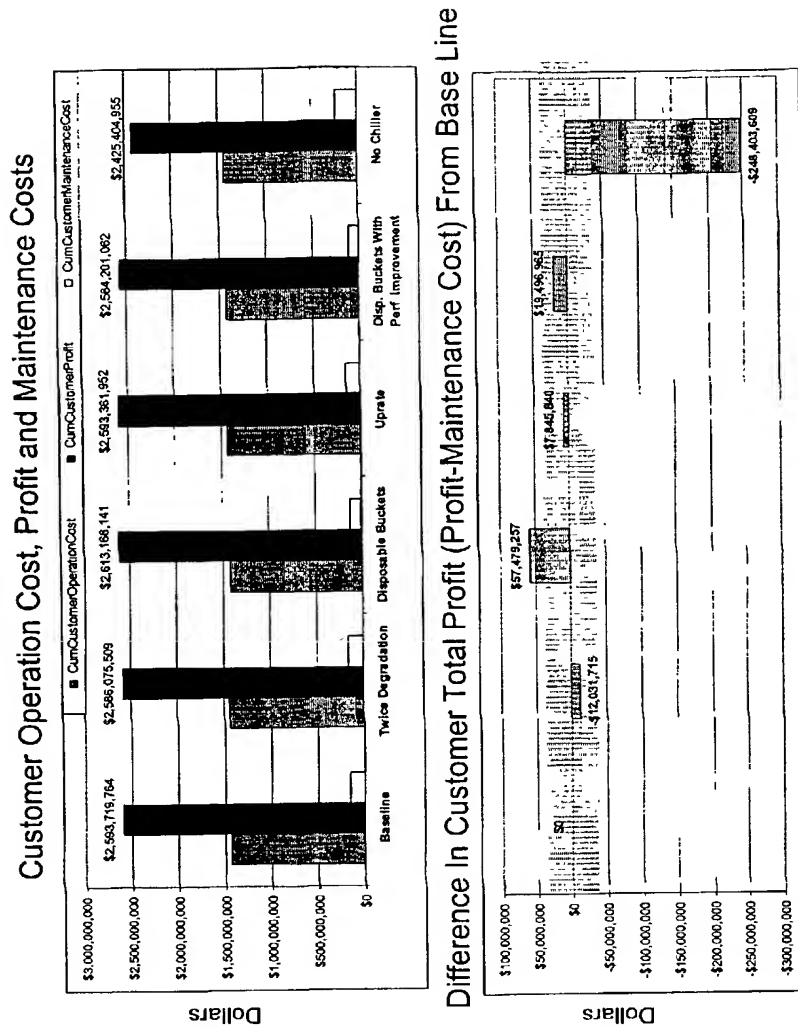


FIG. 10